

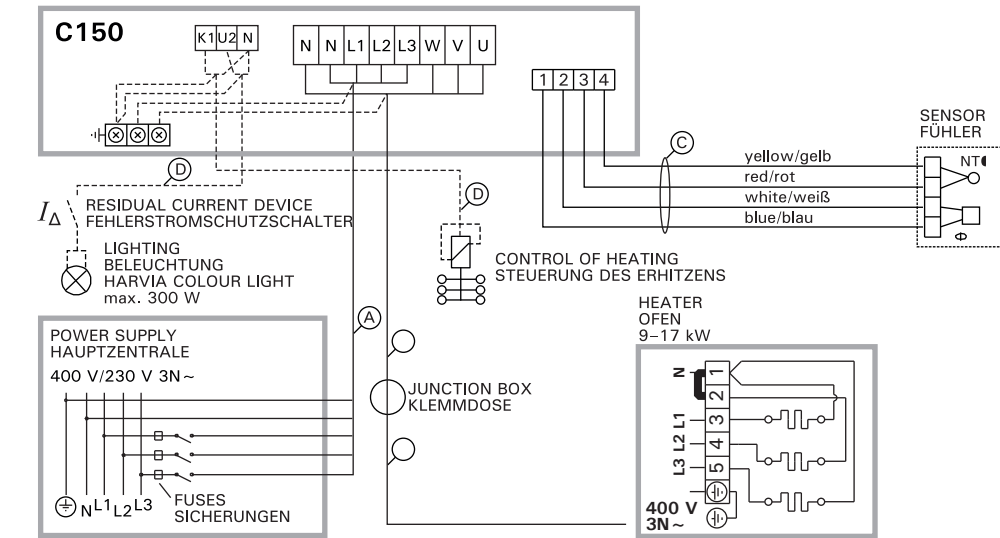


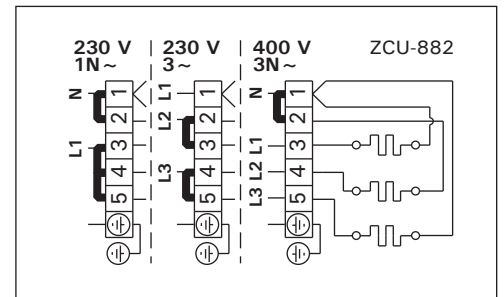

Output Leistung					
	(A)	Fuses Sicherungen	(B) (H07RN-F)	(C) (T170°C)	(D) (SSJ)
kW	mm ²	A	min. mm ²	mm ²	mm ²
0-6,9	5 x 1,5		5 x 1,5	4 x 0,25	3 x 1,5
< 7,0-11,0	5 x 2,5	3 x 16	5 x 1,5	4 x 0,25	3 x 1,5
< 11,0-17,0	5 x 6,0		5 x 2,5	4 x 0,25	3 x 1,5

Electrical connections of control unit C150 and HL heater

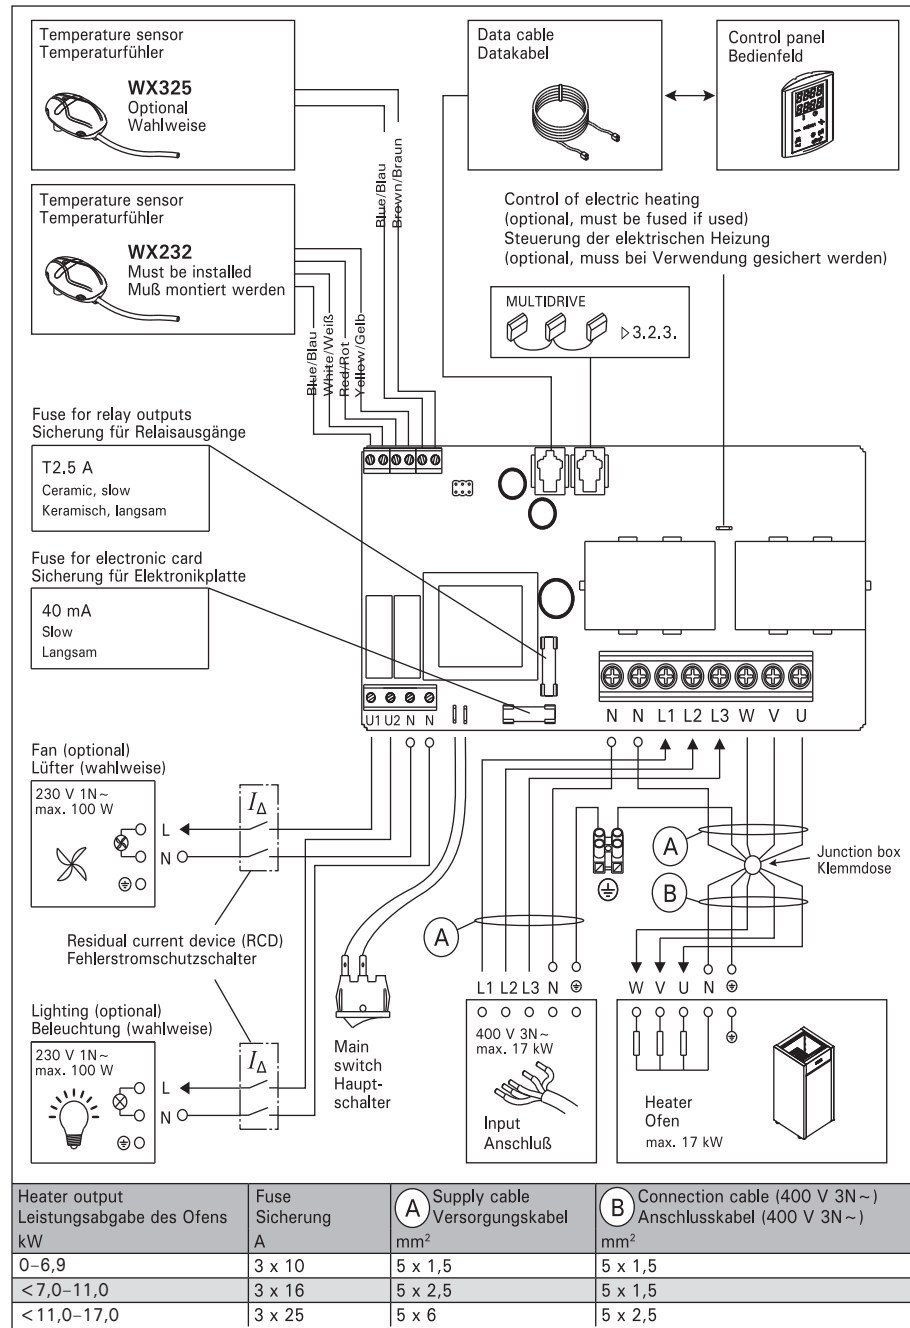

Electrical connections of control unit CG170 and HL heater